



PLAN 2

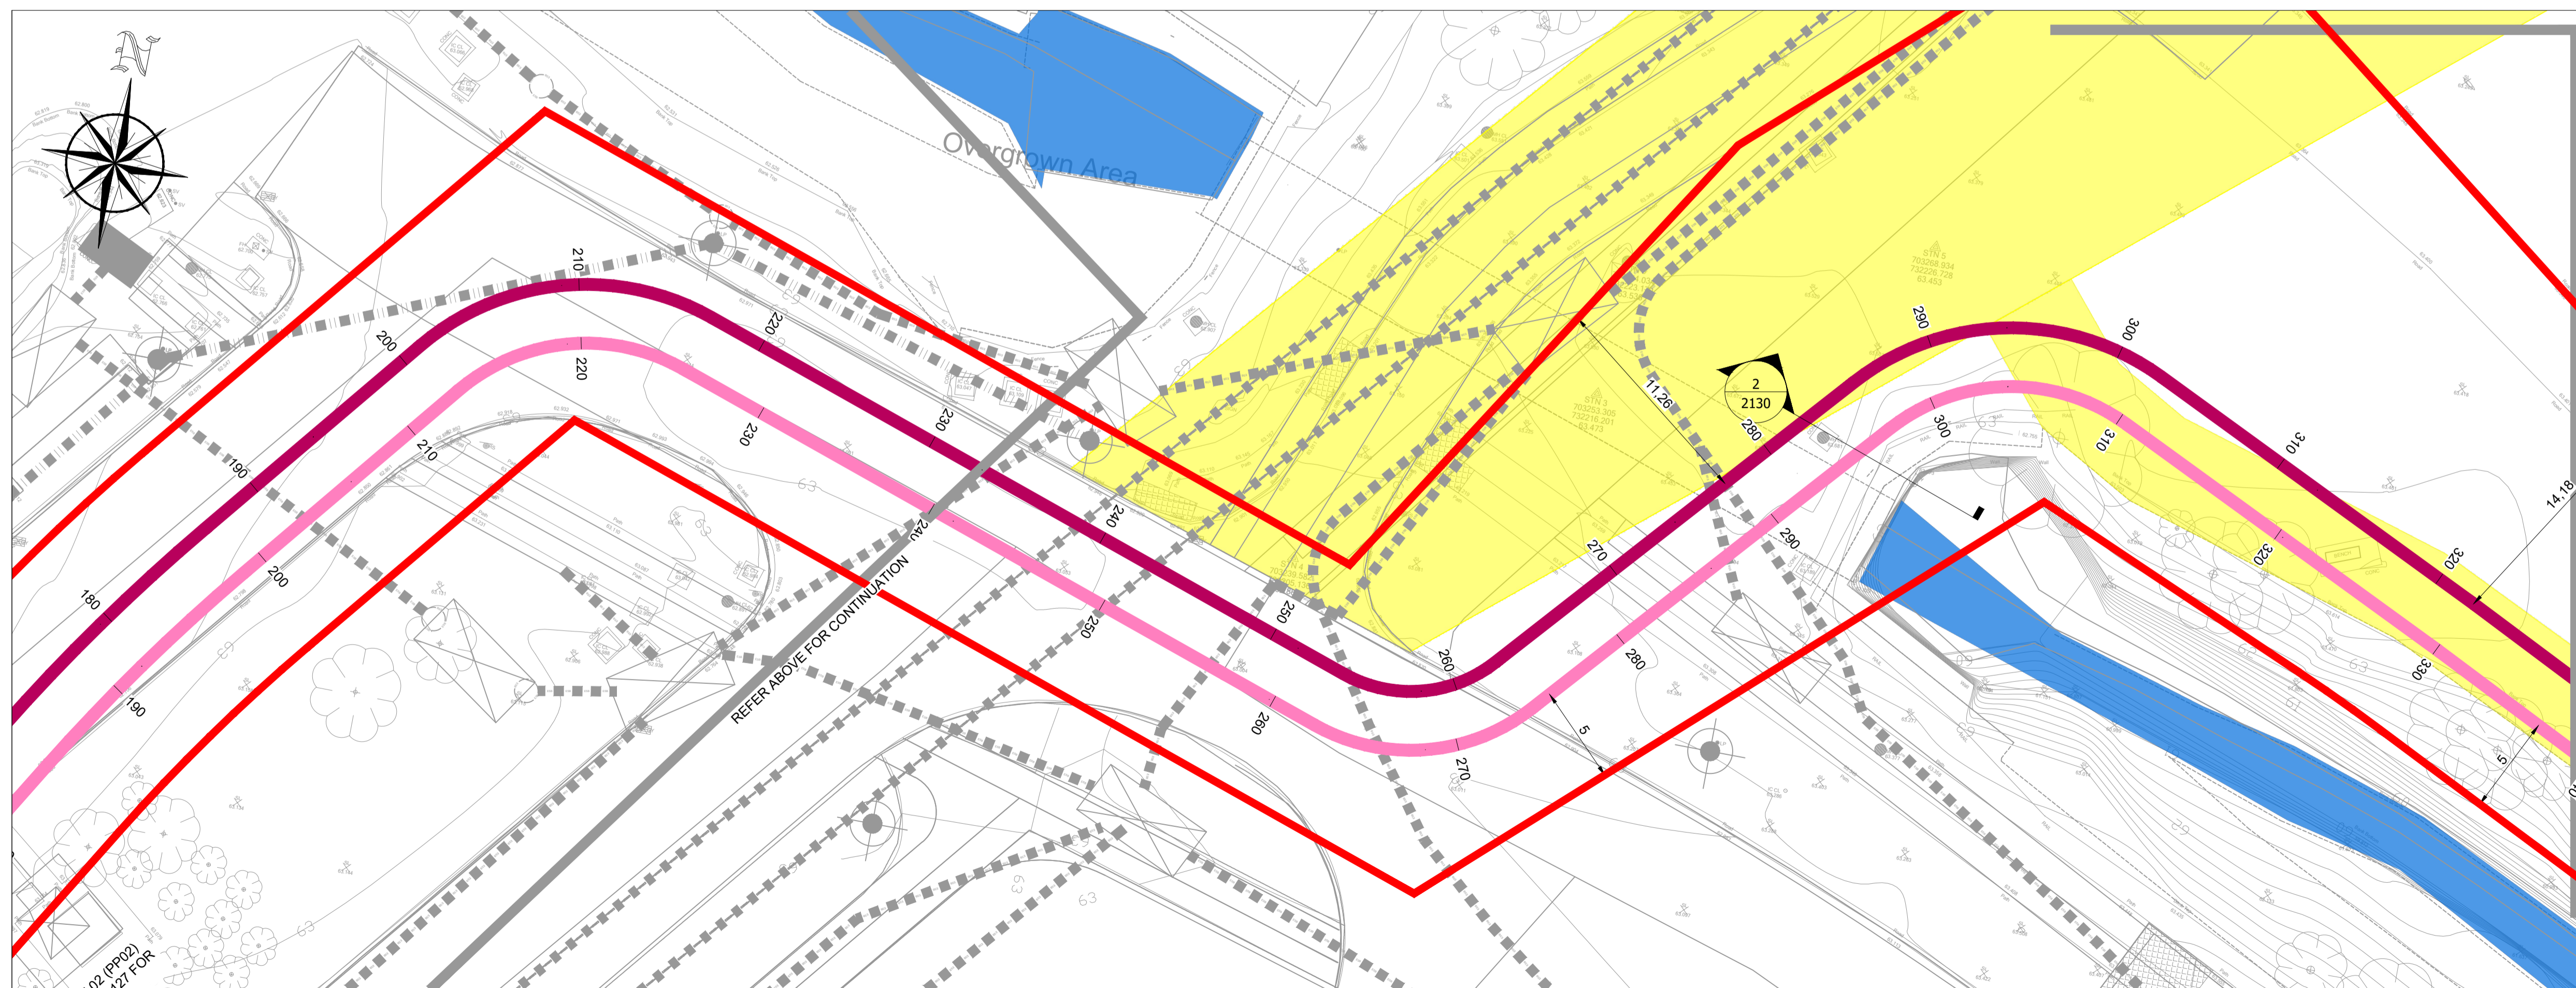

PLAN 3

DRAWING IS PRODUCED USING THE IRISH TRANSVERSE MERCATOR (ITM) GEOGRAPHIC COORDINATE SYSTEM

A1

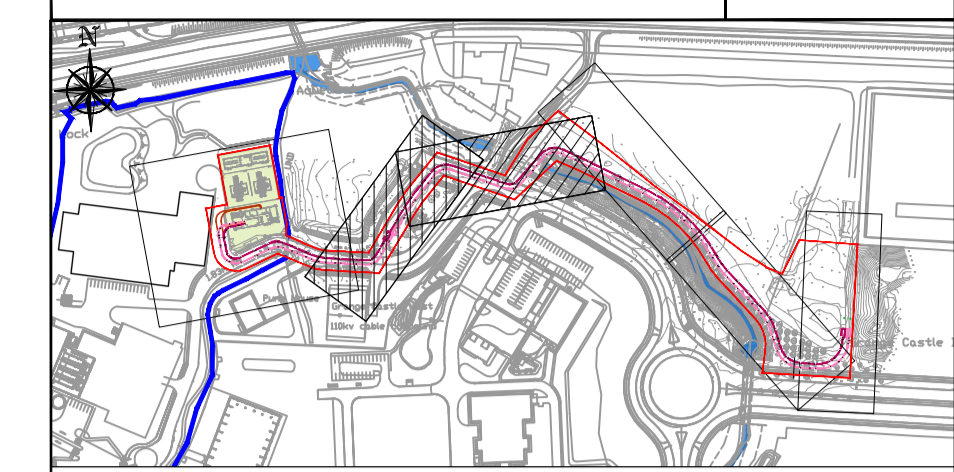

KEYPLAN

- LEGEND:
- PLANNING BOUNDARY
 - PROPERTY BOUNDARY
 - PROPOSED 110KV GRANGE CASTLE TO COOLDERRIG No.1 CIRCUIT
 - PROPOSED 110KV GRANGE CASTLE TO COOLDERRIG No.2 CIRCUIT
 - PROPOSED FUTURE 110KV DUCTING
 - PROPOSED COMMS CABLES
 - - - EXISTING MV/LV UNDERGROUND CIRCUITS
 - - - EXISTING 110KV UNDERGROUND CIRCUITS
 - - - EXISTING PUBLIC LIGHTING LINES
 - █ EXISTING GRIFFEEN RIVER
 - █ EXISTING WAYLEAVE
 - █ COOLDERRIG SUBSTATION COMPOUND UNDER CONSTRUCTION AS PERMITTED UNDER SDCC REG. REF. SD18A/0298

NOTE:

- THE CABLE DUCTING DEPICTED IN THIS DRAWING IS TO OUR BEST KNOWLEDGE THE INTENDED ALIGNMENT ROUTE. ON INSTALLATION SOME MINOR ADJUSTMENTS MAY ARISE AS PREVIOUSLY UNIDENTIFIED UNDERGROUND SERVICES OR SIMILARLY UNFORESEEN OBSTRUCTIONS MAY ARISE. THE CURRENT ALIGNMENTS WILL BE ADJUSTED TO SUIT ACCORDINGLY.

P05	ISSUE FOR PLANNING	DW	BV	09.04.21
P04	FOR DISCUSSION	DW	BV	01.04.21
P03	FOR DISCUSSION	DW	RG	22.03.21
P02	FOR DISCUSSION	-	-	-
P01	FOR DISCUSSION	-	-	-

Clifton Scannell Emerson Associates Limited
Consulting Engineers,
Seaford Lodge,
Castledare Avenue,
Blackrock, Co. Dublin,
Ireland, A94 P768

T. +353 1 288 5006
F. +353 1 283 3466
E. info@csea.ie
W. www.csea.ie

Client		BCEI	
Project		EDGECONNEX SUBSTATION 110KV CABLE ROUTE	
Dwg. Title		PROPOSED GRID CONNECTION CABLE ROUTE SHEET 2	
Drawn By	DW	Date	DEC 2020
Checked By	RG	Scale	1:200 @ A1
Project Code		Originator	Zone/Phase
20_167 - CSE - GEN - ZZ - DR - C - 2122			
S2		FOR INFORMATION	
P05		PLANNING	