



PLAN 4

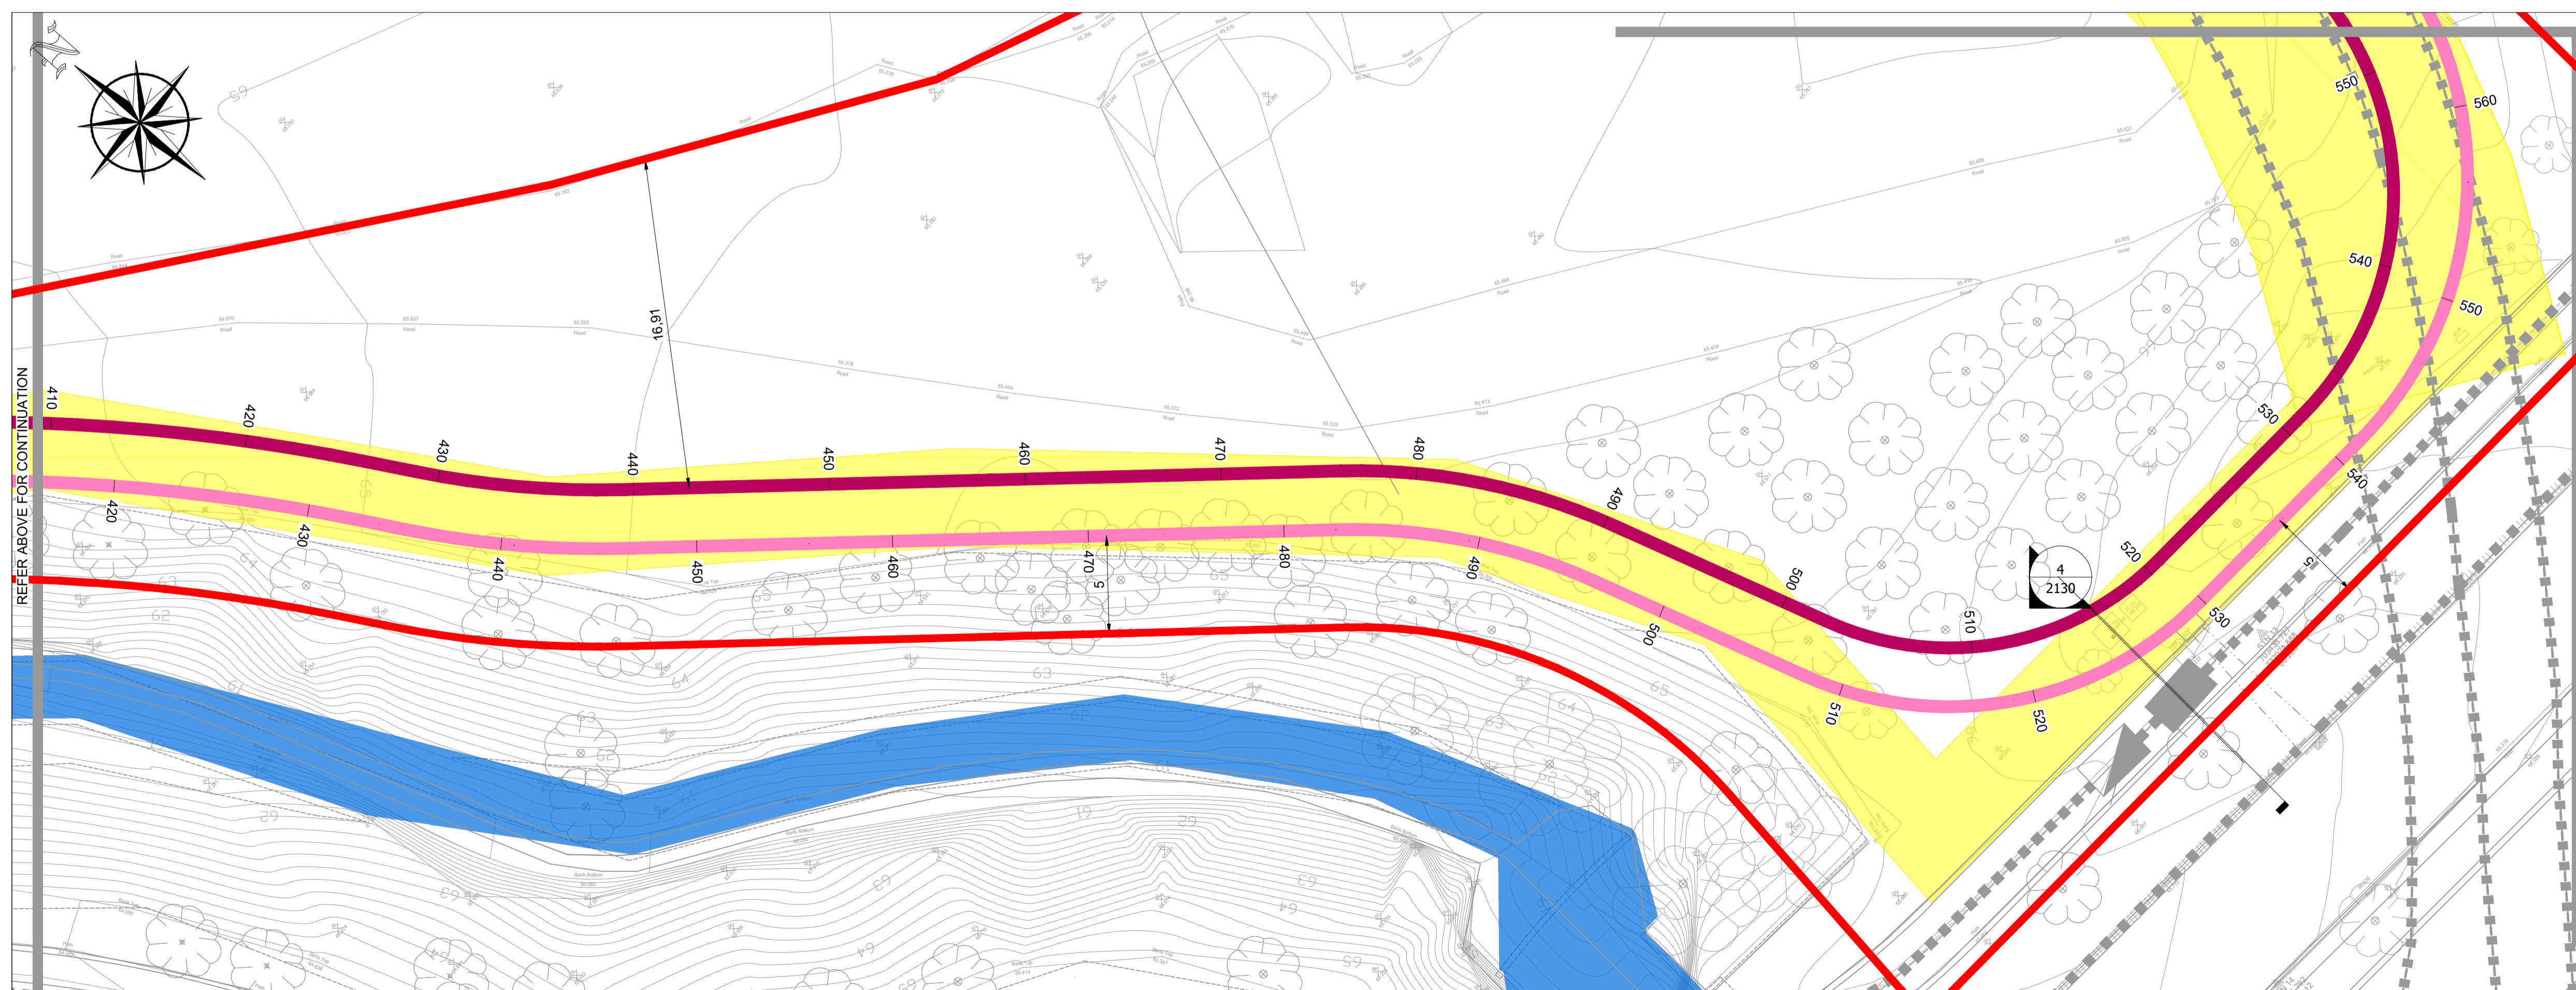

PLAN 5

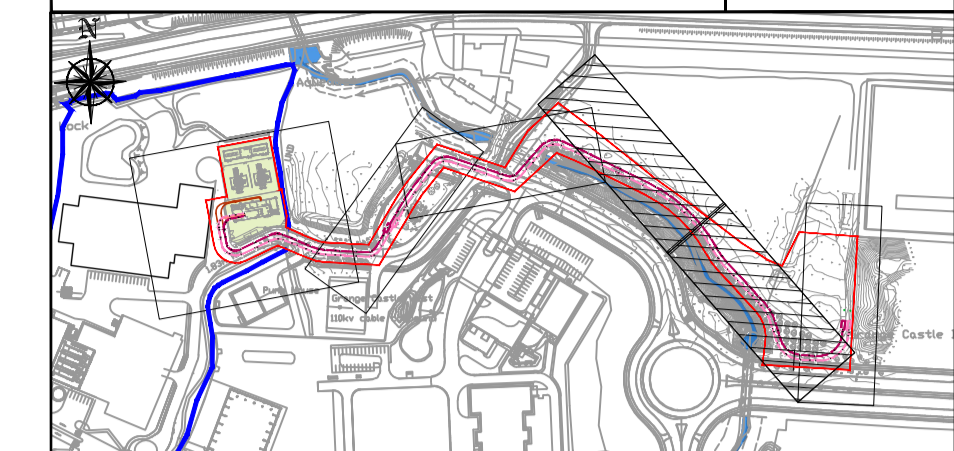

KEYPLAN

- LEGEND:
- PLANNING BOUNDARY
 - PROPERTY BOUNDARY
 - PROPOSED 110KV GRANGE CASTLE TO COOLDERRIG No.1 CIRCUIT
 - PROPOSED 110KV GRANGE CASTLE TO COOLDERRIG No.2 CIRCUIT
 - PROPOSED FUTURE 110KV DUCTING
 - PROPOSED COMMS CABLES
 - - - EXISTING MV/LV UNDERGROUND CIRCUITS
 - - - EXISTING 110KV UNDERGROUND CIRCUITS
 - - - EXISTING PUBLIC LIGHTING LINES
 - █ EXISTING GRIFFEN RIVER
 - █ EXISTING WAYLEAVE
 - █ COOLDERRIG SUBSTATION COMPOUND UNDER CONSTRUCTION AS PERMITTED UNDER SDCC REG. REF. SD18A/0298

NOTE:

1. THE CABLE DUCTING DEPICTED IN THIS DRAWING IS TO OUR BEST KNOWLEDGE THE INTENDED ALIGNMENT ROUTE. ON INSTALLATION SOME MINOR ADJUSTMENTS MAY ARISE AS PREVIOUSLY UNIDENTIFIED UNDERGROUND SERVICES OR SIMILARLY UNFORESEEN OBSTRUCTIONS MAY ARISE. THE CURRENT ALIGNMENTS WILL BE ADJUSTED TO SUIT ACCORDINGLY.

P05	ISSUE FOR PLANNING	DW	BV	09.04.21
P04	FOR DISCUSSION	DW	BV	01.04.21
P03	FOR DISCUSSION	DW	RG	22.03.21
P02	FOR DISCUSSION	-	-	-
P01	FOR DISCUSSION	-	-	-

Rev	Description	Drawn	Checked	Date



Clifton Scannell Emerson Associates
 Associates Limited
 Consulting Engineers,
 Seafort Lodge,
 Castledawson Avenue,
 Blackrock, Co. Dublin,
 Ireland, A94 P768
 T: +353 1 283 5006
 F: +353 1 283 3466
 E: info@csea.ie
 W: www.csea.ie

BCEI	
Client	----
Project	EDGECONNEX SUBSTATION 110KV CABLE ROUTE
Dwg. Title	PROPOSED GRID CONNECTION CABLE ROUTE SHEET 3
Drawn By	DW Date DEC 2020
Checked By	RG Scale 1:200 @ A1 20_167
Project Code	Originator Zone/Phase Level Type Role Dwg. No.
20_167 - CSE - GEN - ZZ - DR - C - 2123	

S2	FOR INFORMATION
Status Code	Suitability Description
P05	PLANNING
Revision	Project Status