


KEYPLAN

- LEGEND:**
- PLANNING BOUNDARY
 - PROPOSED 110KV GRANGE CASTLE TO COOLDERRIG No.1 CIRCUIT
 - PROPOSED 110KV GRANGE CASTLE TO COOLDERRIG No.2 CIRCUIT
 - 110KV DUCT SDR 21 HDPE
 - COMMS DUCT SDR 17.6 HDPE
 - EXISTING MV/LV UNDERGROUND CIRCUITS
 - EXISTING 110KV UNDERGROUND CIRCUITS

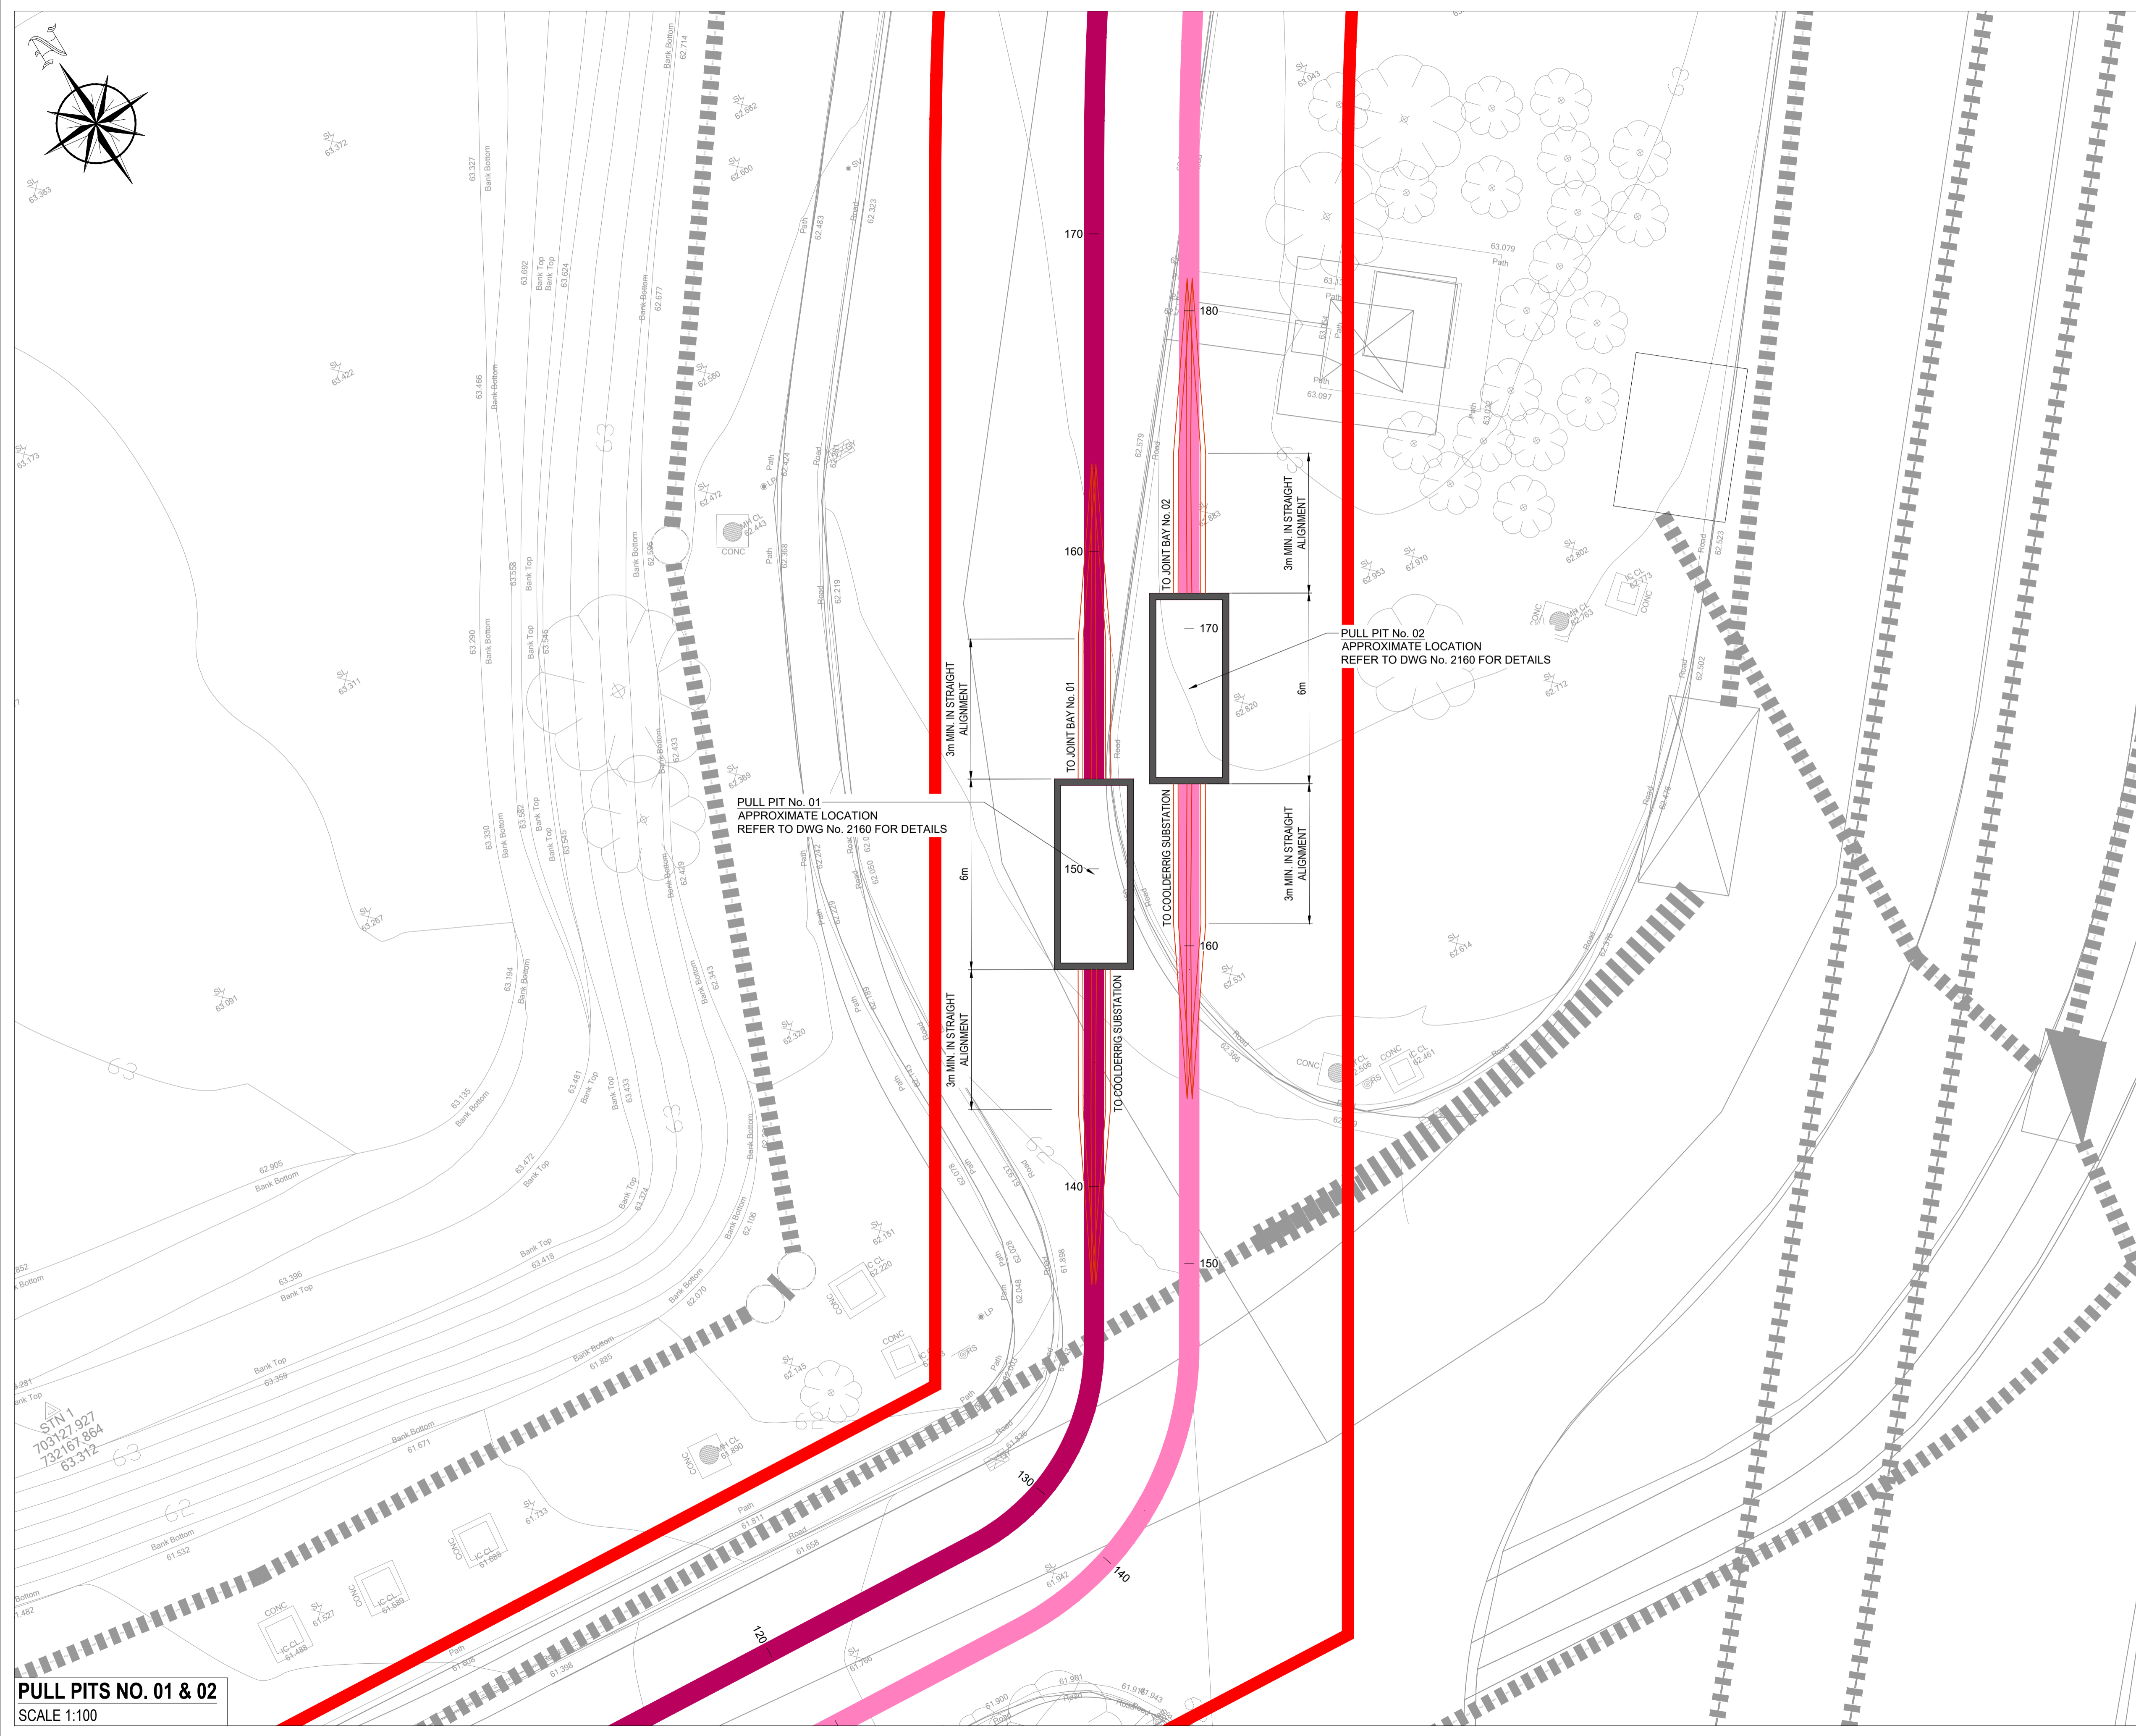

PULL PITS NO. 01 & 02
SCALE 1:100

P04	ISSUE FOR PLANNING	DW	BV	09.04.21
P03	FOR DISCUSSION	DW	BV	01.04.21
P02	FOR DISCUSSION	DW	RG	22.03.21
P01	-	-	-	-
Rev	Description	Drawn	Checked	Date

Clifton Scannell Emerson Associates
Clifton Scannell Emerson Associates Limited
Consulting Engineers,
Seaforth Lodge,
Castledawson Avenue,
Blackrock, Co. Dublin,
Ireland, A94 P768
T: +353 1 288 5006
F: +353 1 283 3466
E: info@csea.ie
W: www.csea.ie

Client		BCEI	
Project		EDGECONNEX SUBSTATION 110KV CABLE ROUTE PROPOSED PULL PIT PP01 & PP02	
Dwg. Title	DW	Date	MAR 2021
Drawn By	RG	Scale	1:100 @ A1
Checked By		Scale	CSEA Job No.
Project Code	Originator	Zone/Phase	Level
Type	Role	Dwg. No.	
20_167 - CSE - GEN - ZZ - DR - C - 2127			
S2 FOR INFORMATION			
Status Code		Suitability Description	
P04 FOR INFORMATION			
Revision		Project Status	