


WALL OPENINGS 450x325 MAX. ACTUAL SIZE TO BE FORMED TO SUIT DUCT ENTRIES. VOIDS TO BE SEALED AND SURFACES MADE GOOD WITH CLASS 1 MORTAR.

GALVANISED STEP IRONS TO BE FITTED IN ALL BOXES DEEPER THAN 700MM. POSITIONED AT THE END REMOTE FROM ANY SIDE ENTRY DUCT OR AS DIRECTED BY THE ENGINEER, AND AWAY FROM SUMP.


COMMUNICATION CHAMBER PLAN

COVER, FRAME & DUCTS OMITTED FOR CLARITY
SCALE 1:20

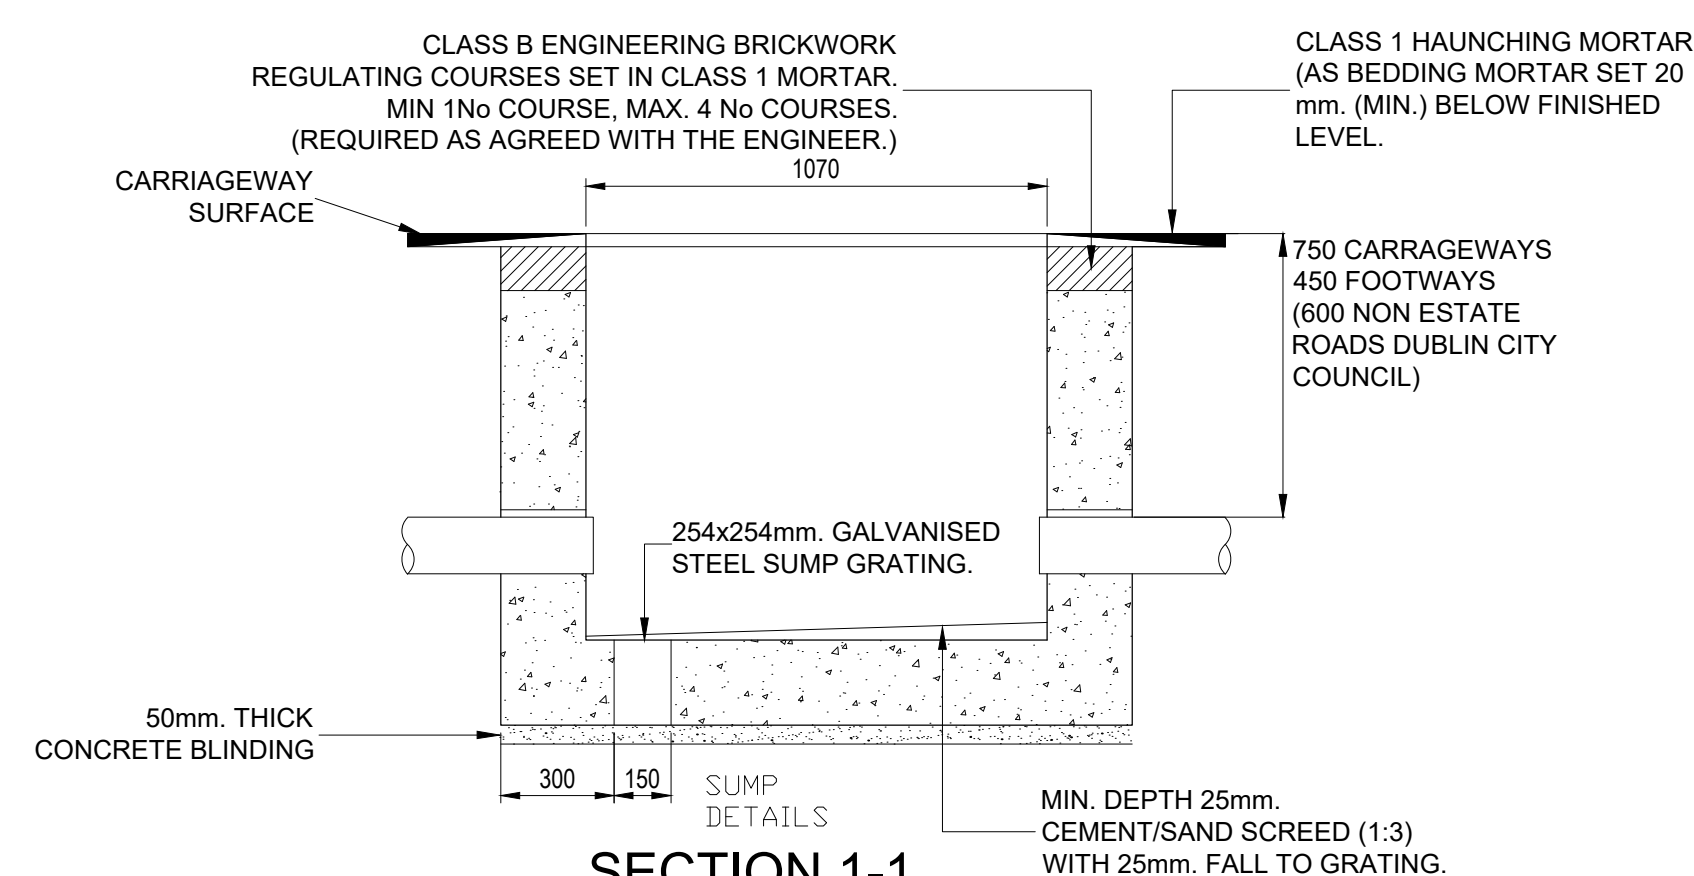

SECTION 1-1

SCALE 1:20

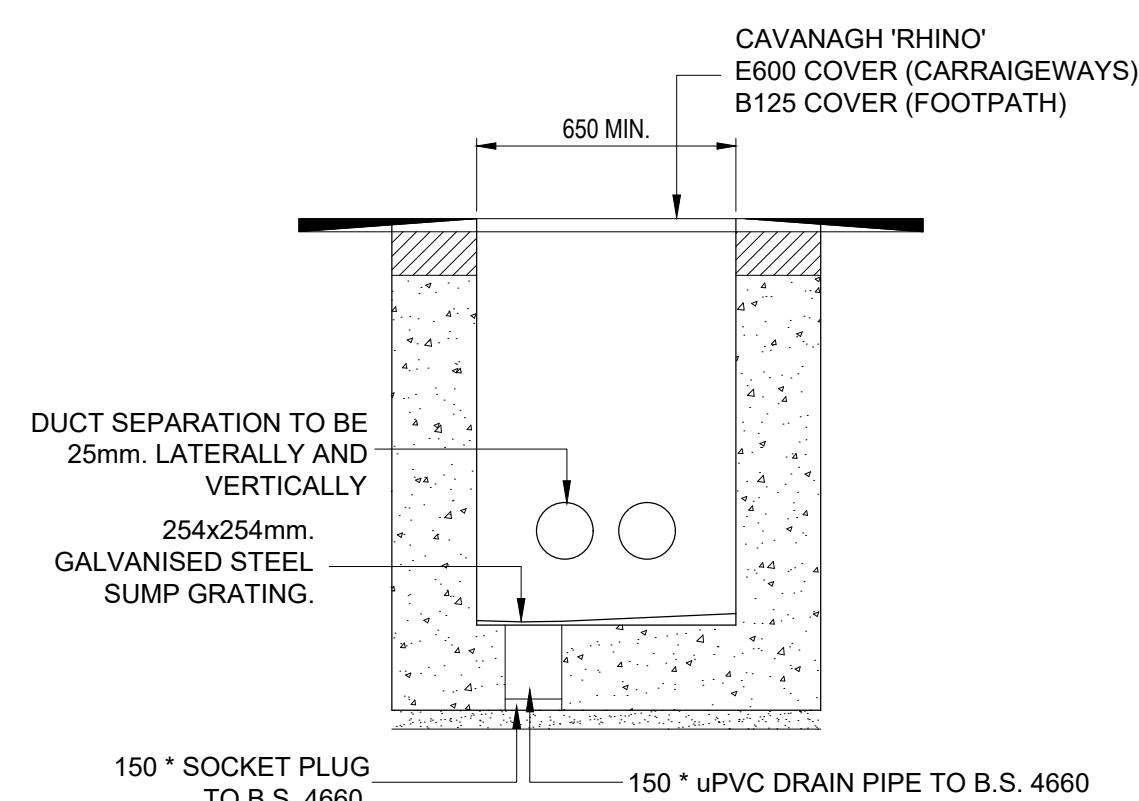

SECTION 2-2

SCALE 1:20

Rev	Description	Drawn	Checked	Date
P05	ISSUE FOR PLANNING	DW	BV	09.04.21
P04	FOR DISCUSSION	DW	BV	01.04.21
P03	FOR DISCUSSION	DW	RG	22.03.21
P02	FOR DISCUSSION	-	-	-
P01	FOR DISCUSSION	-	-	-

Clifton Scannell Emerson Associates
 Consulting Engineers,
 Salford Lodge,
 Castledawson Avenue,
 Blackrock, Co. Dublin,
 Ireland, A94 P768
 T: +353 1 288 5006
 F: +353 1 283 3466
 E: info@csea.ie
 W: www.csea.ie

BCEI
 Client: ----
 Project: **EDGECONNEX SUBSTATION
 110KV CABLE ROUTE
 LINK BOX & COMMUNICATIONS
 CHAMBER G.A. AND DETAILS**
 Dwg. Title: **20_167**
 Drawn By: DW Date: DEC 2020
 Checked By: RG AS INDICATED @ A1 Scale: CSEA Job No.
 Project Code: S2 Originator: Zone/Phase: Level: Type: Role: Dwg. No.:
20_167 - CSE - GEN - ZZ - DR - C - 2161
 Status Code: S2 Suitability Description: FOR INFORMATION
 Revision: P05 Project Status: PLANNING