


A number of trees along the bottom of the river bank  
(5 no. *Salix alba* 'Tristis', 1 no. *Alnus glutinosa*,  
1 no. *Betula pendula*) are unlikely to be impacted by works

4no. *Metasequoia glyptostroboides*  
to be retained

Area of Dogwood *Cornus alba* may be impacted by works

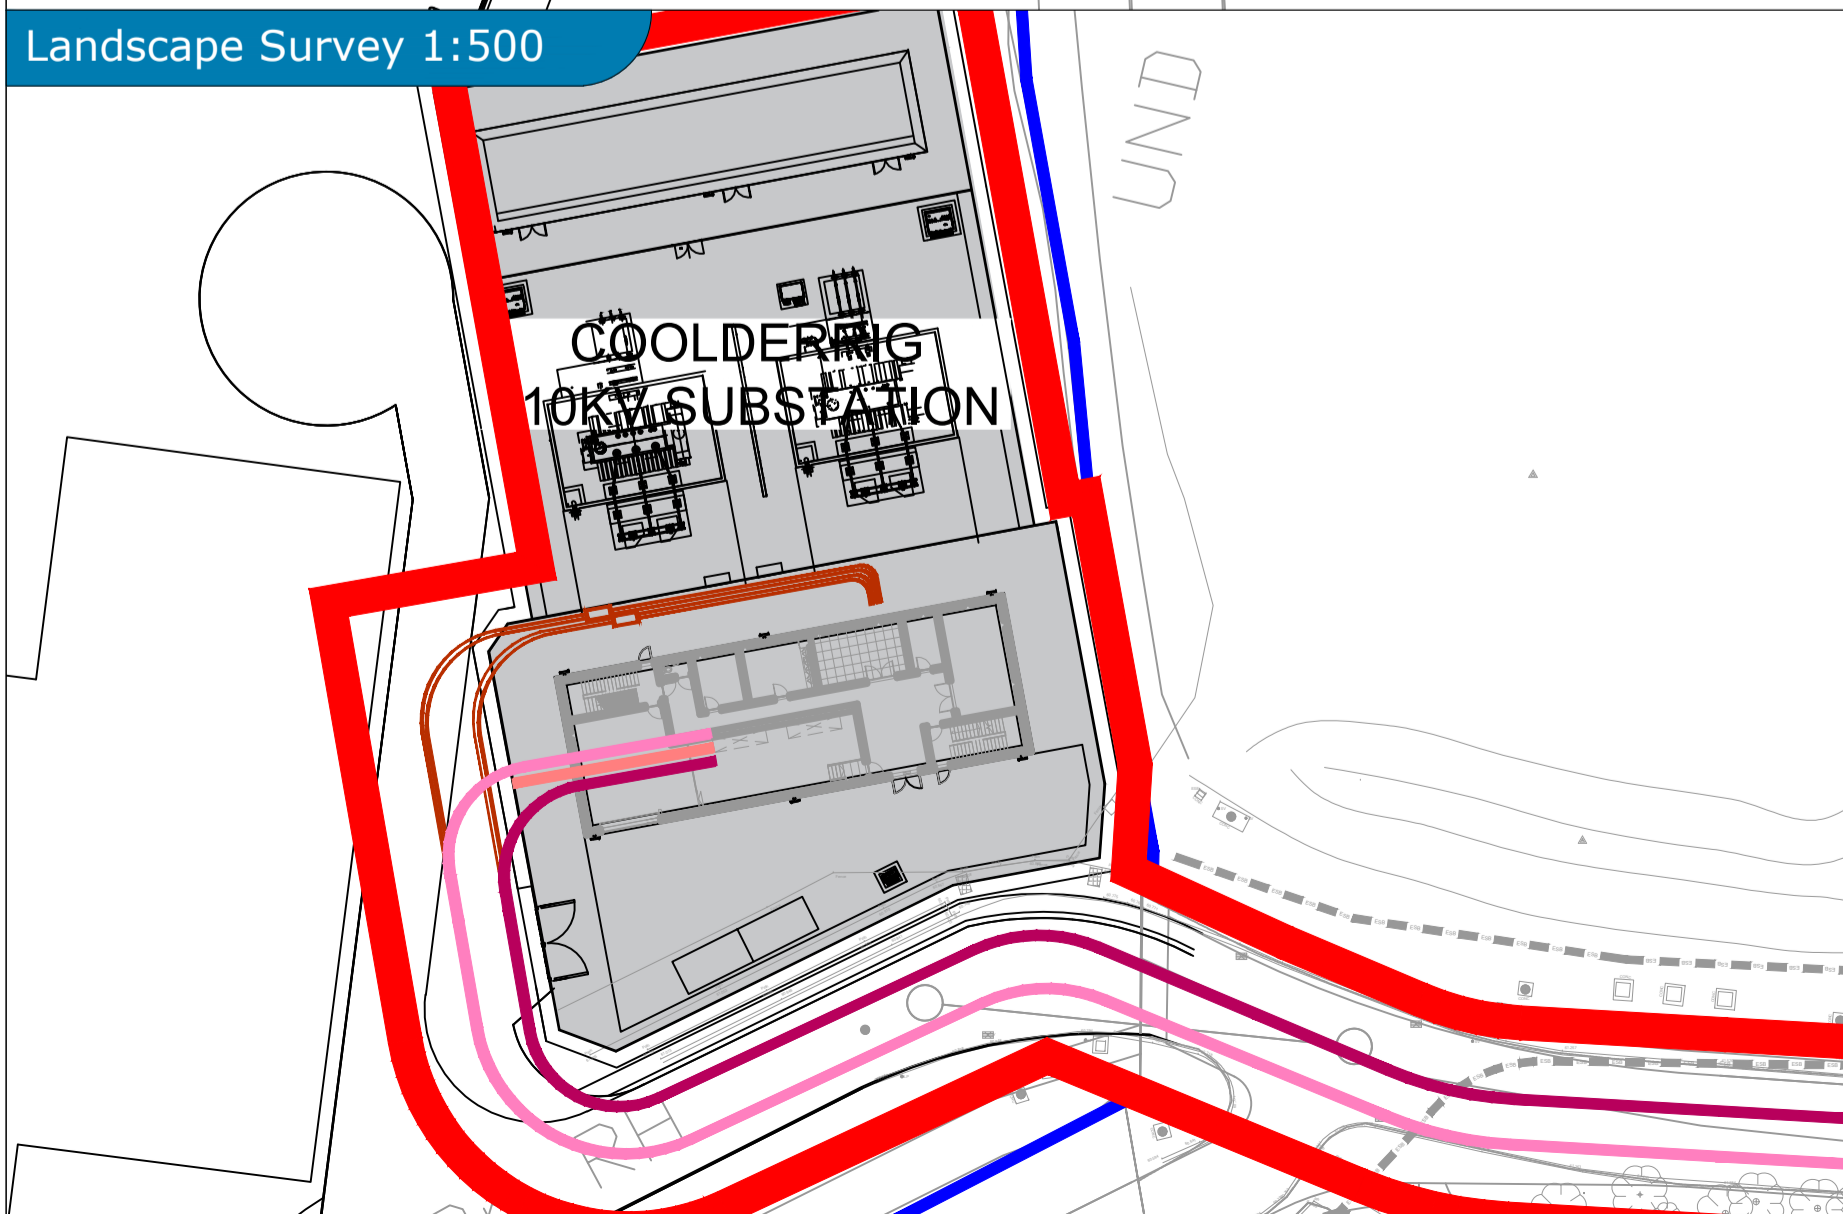

Legend

TREES AND PLANTING TO BE REMOVED

- Area of trees along top of bank impacted by works. Most trees recorded are semi-mature.
- Pinus sylvestris* 13 no.
- Salix alba* 'Tristis' 1 no.
- Betula pendula* 12 no.
- Fraxinus excelsior* 8no. (2 no. juvenile)
- Acer campestre* 13 no.
- Alnus glutinosa* 8no.
- Aesculus hippocastanum* 1no (juvenile)
- Acer platanoides* 1no.
- Sorbus aria* 2no.
- Cornus alba* 25m x 1m

- Metasequoia glyptostroboides* 25no.

- 110kv Duct line

Rev	Date	By	Details
C	09/04/21	EOD	Updated cable
B	08/04/21	EOD	Updated boundaries
A	16/03/21	LJ	Landscape survey

**AUSTEN ASSOCIATES**  
 Renshaw House, Ballygate Beg, Wicklow Town, Co. Wicklow, A67 XH82  
 T: 0404 66027  
 Email: [designdesk@austenassociates.ie](mailto:designdesk@austenassociates.ie) | Web: [www.austenassociates.ie](http://www.austenassociates.ie)  
 landscape architecture | arboriculture  
 design | project management  
 Copyright Austen Associates, 2021

Client:  
Cliften Scannel Emerson Associates

Project title:  
Edgeconnex 110kv Duct

Drawing title:  
Landscape Survey

Drawn by: LJ Scale: 1:500 on A1

Approved by: EOD Date: March 2021

Status: Tender

Drawing no: 070321\_LS\_01 Revision: C